




Recessed Wall Mount with 1/2" drywall

#### Parts

LED fixture Housing 2 x Wire Connectors Mounting screws (supplied by others)

- 1) Turn off power prior to installation.
- Drill 7/8" hole in fixture housing in appropriate location for the power feed.
- 3) Mount fixture housing by screwing housing to framing or support, using the screw-ports on the side of the fixture (screws provided by others). Place screws approximately 2" from housing ends and evenly spaced to a maximum of 2' apart. Ensure fixture is level.
- 4) Install drywall, butt up to edges of housing
- 5) Install mudding tape to cover the gap, ensuring tape does not overlap inside of the fixture housing.
- 6) Apply layers mud / joint compound over the tape and gap with a drywall knife. Ensure no mudding drys on inside of the housing.

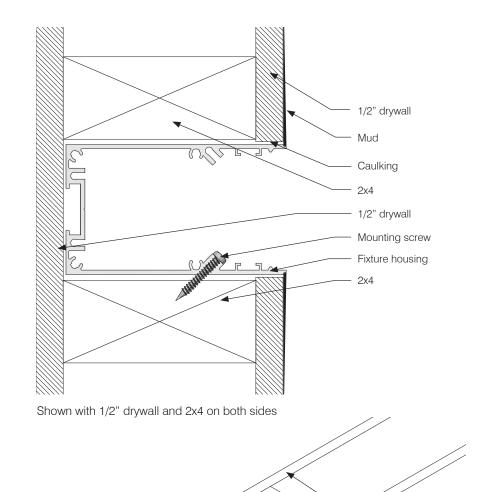

1/2" drywall

1/2" drywall

Fixture housing

2x4




Recessed Wall Mount with 5/8" drywall

#### Parts

LED fixture Housing 2 x Wire Connectors Mounting screws (supplied by others)

- 1) Turn off power prior to installation.
- Drill 7/8" hole in fixture housing in appropriate location for the power feed.
- 3) Mount fixture housing by screwing housing to framing or support, using the screw-ports on the side of the fixture (screws provided by others). Place screws approximately 2" from housing ends and evenly spaced to a maximum of 2' apart. Ensure fixture is level.
- 4) Install drywall, butt up to edges of housing
- 5) Install mudding tape to cover the gap, ensuring tape does not overlap inside of the fixture housing.
- 6) Apply layers mud / joint compound over the tape and gap with a drywall knife. Ensure no mudding drys on inside of the housing.

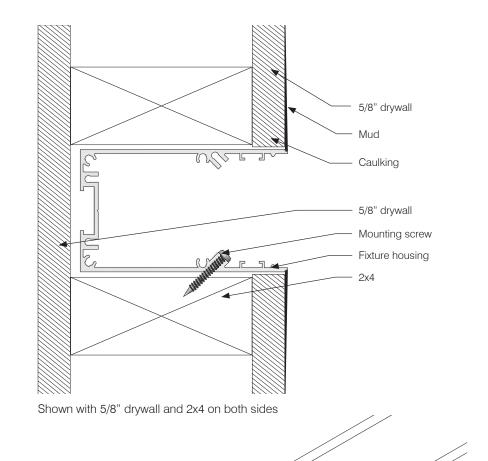

5/8" drywall

5/8" drywall

Fixture housing

09-2020

2x4




L122 Recessed Wall Mount

Parts

LED fixture Housing 2 x Wire Connectors Mounting screws (supplied by others)

- 1) Turn off power prior to installation.
- Drill 7/8" hole in fixture housing in appropriate location for the power feed.
- 3) Mount fixture housing by screwing housing to framing or support (screws provided by others).
  Place screws approximately 2" from housing ends and evenly spaced to a maximum of 2' apart.
  Ensure fixture is level.
- 4) Install drywall, butt up to edges of housing
- 5) Install mudding tape to cover the gap, ensuring tape does not overlap inside of the fixture housing.
- Apply layers mud / joint compound over the tape and gap with a drywall knife. Ensure no mudding drys on inside of the housing.

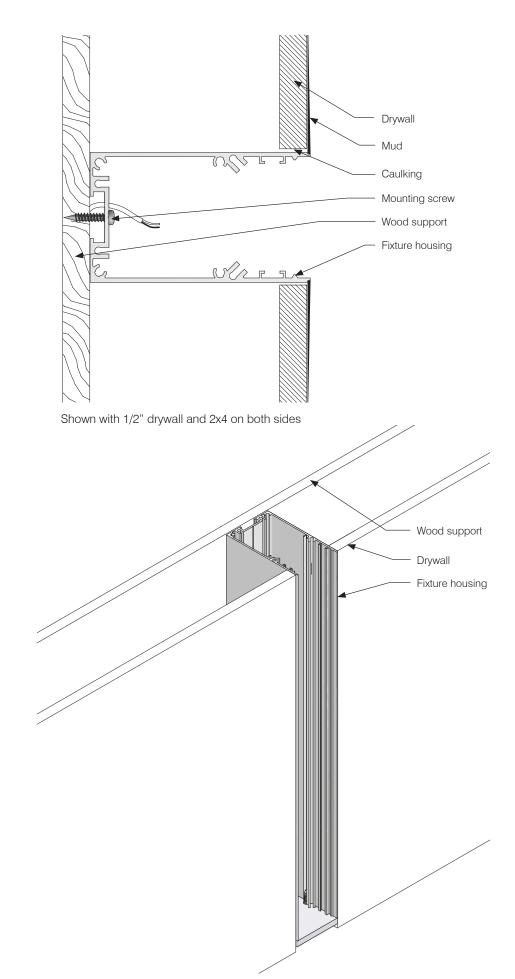





Surface Mount

#### Parts

LED fixture Housing 2 x Wire Connectors Mounting screws (supplied by others)

- 1) Turn off power prior to installation.
- Drill 7/8" hole in fixture housing in appropriate location for the power feed.
- Mount fixture housing by screwing housing to additional support behind drywall (screws provided by others). Place screws approximately 2" from housing ends and evenly spaced to a maximum of 2' apart. Ensure fixture is level.

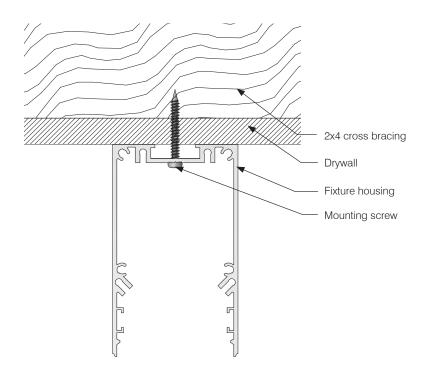

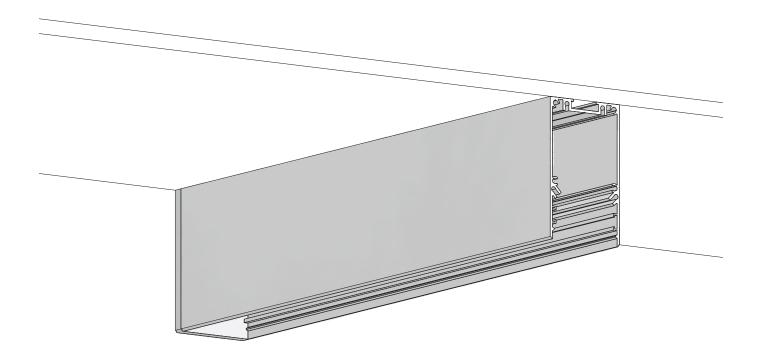



Recessed Ceiling Mount


#### Parts


LED fixture Housing 2 x Wire Connectors Mounting screws (supplied by others)

- 1) Turn off power prior to installation.
- Drill 7/8" hole in fixture housing in appropriate location for the power feed.
- 3) Box in fixture with 2x4 framing
- Mount fixture housing by screwing housing to 2x12 or 2x10 ceiling joist. Place screws approximately 2" from housing ends and evenly spaced to a maximum of 2' apart. Ensure fixture is level.
- 5) Install drywall, butt up to edges of housing leaving a 1/8" gap for caulking.
- Apply layers mud / joint compound over the gap with a drywall knife. Ensure no mudding drys on inside of the housing.

[▶] MPLIGHTING®

www.mplighting.com t 1.877.708.1184 f 604.708.1185

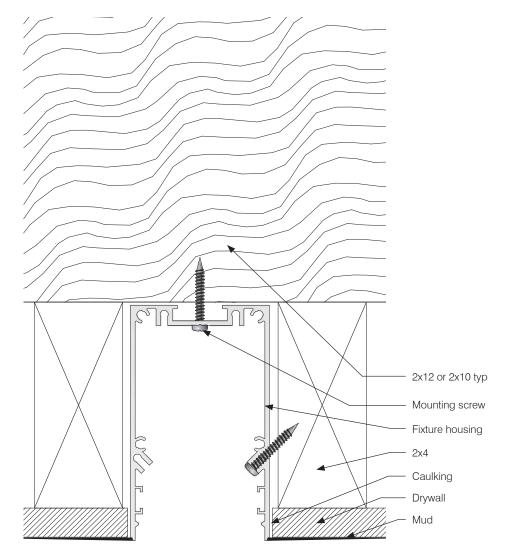

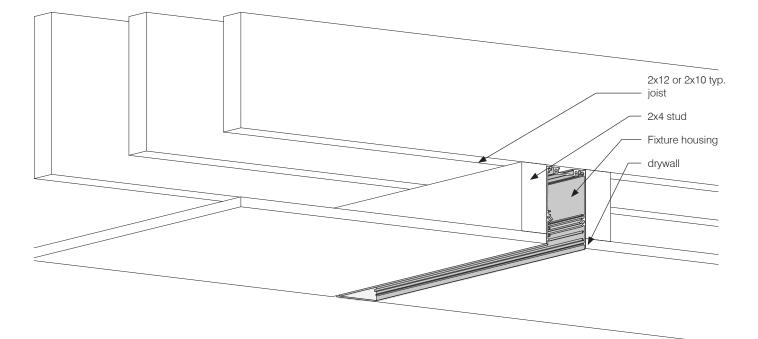


Fixture Assembly

#### Parts

LED fixture Housing 2 x End Caps Lens LED rail Springs Driver & driver housing

- Make power connection to driver wires. Secure driver and driver housing to fixture housing.
- Mount springs into screw ports on fixture housing, placing springs evenly.
- Push LED rail into spring until it snaps into place. Ensure the LED rail is secure.
- Install lens by pushing it up into the fixture housing until it snaps into place and is secure.
- \*To attach end caps push the 4 pins into the screw-ports on the end of the fixture housing.

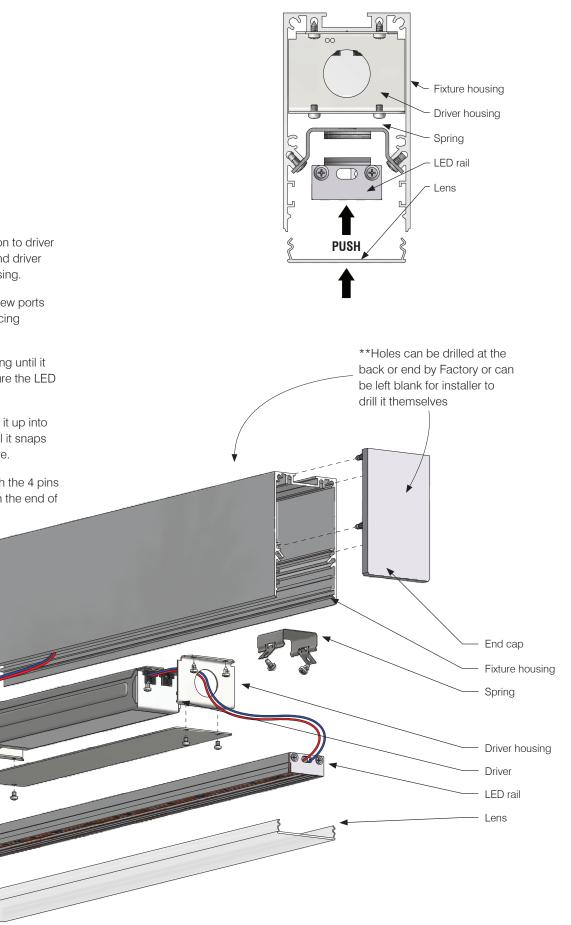

[▶] MPLIGHTING®

# **IMPORTANT SAFETY INSTRUCTIONS**

KEEP THESE INSTALLATION INSTRUCTIONS (Including General and Additional Markings for Fixtures) (FOR MP LIGHTING LED LUMINAIRES, CLASS 3402-xx)

General and additional markings

- 1. For Use Only with Certified/NRTL Driver, Model
- 2. DRY LOCATIONS ONLY or OUTDOOR USE ONLY or DRY/ OUTDOOR USE ONLY or Outdoor / submersible Use Only - as indicated on fixtures
- 3. MIN 90 C SUPPLY CONDUCTORS
- 4. Models L01, L03, L04, L05, L06, and L07: SUITABLE FOR USE IN POURED CONCRETE, USE ON CLASS 2 CIRCUIT ONLY

Installation instructions

- 1. The grounding installation shall be done in accordance with CEC-Part 1.
- 2. WARNING: RISK OF FIRE OR ELECTRIC SHOCK: DO NOT MAKE OR ALTER ANY OPENINGS IN THE COMPARTMENT OF WIRING OR ELECTRICAL COMPONENTS DURING INSTALLATION. DO NOT ALTER OR ADD BALLASTS, OR ANY OTHER ELECTRICAL COMPONENTS.
- 3. INSTALLATION AND USE OF THIS FIXTURE MOUNTING ASSEMBLY REQUIRES A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF LUMINAIRE ELECTRICAL SYSTEMS AND THE HAZARD INVOLVED, IF NOT QUALIFIED, DO NOT ATTEMPT INSTALLATION. CONTACT A QUALIFIED ELECTRICIAN.
- 4. TURN OFF POWER BEFORE INSTALLATION.
- 5. KEEP THESE INSTALLATION INSTRUCTIONS.

## \Lambda CONSIGNES DE SÉCURITÉ IMPORTANTES

CONSERVER CES INSTRUCTIONS D'INSTALLATION

(Dont le général et marques supplémentaires pour les appareils) (Pour les luminaires LED MP D'ÉCLAIRAGE, CLASS 3402 -xx)

Général et marquages supplémentaires

- 1. A utiliser uniquement avec Certified / NRTL pilote, modèle
- 2. POUR EMPLACEMENTS SECS SEULEMENT ou UTILISATION EXTÉRIEURE SEULEMENT ou SEC / UTILISATION EXTÉRIEURE SEULEMENT ou extérieure / Utilisation submersible seulement comme indiqué sur les appareils
- 3. LES FILS D'ALIMENTATION 90 °C MIN
- 4. Modèles L01, L03, L04, L05, L06, L07 et: utilisables dans le béton coulé, UTILISATION DE CLASSE 2 CIRCUIT UNIQUEMENT

Les instructions d'installation

- 1. L'installation de mise à la terre doit être fait en conformité avec CEC Partie 1.
- 2. AVERTISSEMENT : RISQUE D'INCENDIE OU D'ÉLECTROCUTION : NE PAS FAIRE OU MODIFIER DES OUVERTURES DANS LE COMPARTIMENT DE CÂBLAGE OU DE COMPOSANTS ÉLECTRIQUES LORS DE L'INSTALLATION. NE PAS MODIFIER OU AJOUTER DES BALLASTS, OU AUTRES COMPOSANTS ÉLECTRIQUES
- 3. CE PRODUIT DOIT ÊTRE INSTALLÉ SELON LE CODE D'INSTALLATION PERTINENT, PAR UNE PERSONNE QUI CONNAÎT BIEN LE PRODUIT ET SON FONCTIONNEMENT AINSI QUE LES RISQUES INHÉRENTS. CONSULTER UN ÉLECTRICIEN QUALIFIÉ.
- 4. COUPER LE COURANT AVANT L'INSTALLATION.
- 5. CONSERVEZ CES INSTRUCTIONS.

[▶] MPLIGHTING<sup>®</sup> www.mplighting.com t1.877.708.1184 f604.708.1185